READ COMPLETE SAFETY INSTRUCTIONS AND INSTALLATION TEMPLATE BEFORE STARTING INSTALLATION

ATTENTION INSTALLER:

This product must be installed by a qualified heating and air conditioning contractor. Failure to do so could result in serious injury from electrical shock. This product must be installed in compliance with all local, state and federal codes.

Proper humidification and humidity control also requires that the home be constructed in accordance with local codes and good building practices.

Aprilaire[®] MODEL 500 SERIES HUMIDIFIER TEMPLATE

1. ELECTRICAL SHOCK HAZARD.

- Disconnect electrical power to the furnace before starting installation. Failure to do so could result in serious injury from electrical shock.
- 2. SHARP EDGES HAZARD. Sharp edges may cause serious injury from cuts. Use care when making plenum openings and handling ductwork.
- 3. RISK OF SCALDING. HOT water can cause severe burns and scald instantly. Shut off the hot water supply before disconnecting or tapping into any hot water supply line.

ACAUTION

RISK OF PROPERTY AND EQUIPMENT DAMAGE.

- 1. Do not install humidifier where freezing temperatures could occur. The water line could freeze and crack causing water damage to the home.
- 2. Do not install humidifier or bypass connection on the furnace jacket.
- 3. Do not install humidifier or bypass connection on a plenum face where the blanked off ends of the cooling coil will restrict air movement through the humidifier.
- 4. Do not set humidity level above recommended or to recommended level if condensation exists on inside windows of any unheated space, as condensation damage may result. Excess humidity can cause moisture accumulation which can allow the possibility for mold growth in the home.
- 5. Do not connect Model 500 or 500M transformer to blower motor wiring. Premature component failure may result.
- 6. When installing Humidifier Control on downflow furnace, ensure blower continues to run after a heat call is satisfied to eliminate high temperatures from damaging the Humidifier Control.
- 7. Do not install humidifier where water pressure exceeds 125 psi, since damage to the humidifier may result. Follow codes in effect concerning pressure reduction.
- 8. Do not install humidifier on systems with greater than 0.4 in. wg pressure differential between supply and return plenums. Zoned HVAC systems may increase the risk of higher than normal static pressure.

SPECIFICATIONS

HUMIDIFIER DIMENSIONS

Width (including solenoid valve): 15 5/8" Height (including drain spud): 13" Depth: 101/4"

BYPASS DUCT OPENING

6" diameter

PLENUM OPENING 91/2"W x 91/2"H

WATER FEED RATE 3 gph

ELECTRICAL DATA 24 VAC-60 Hz, 0.5 AMP

INSTALLATION OPTIONS

The Model 500 and 500M Aprilaire can


SUPPLY

SUPPLY

90-1079

RECOMMENDED WIRING DIAGRAMS

(SEE STEP 7 ON BACK AND "HUMIDIFIER CONTROL SAFETY AND INSTALLATION INSTRUCTIONS" FOR DETAILED WIRING INSTRUCTIONS)

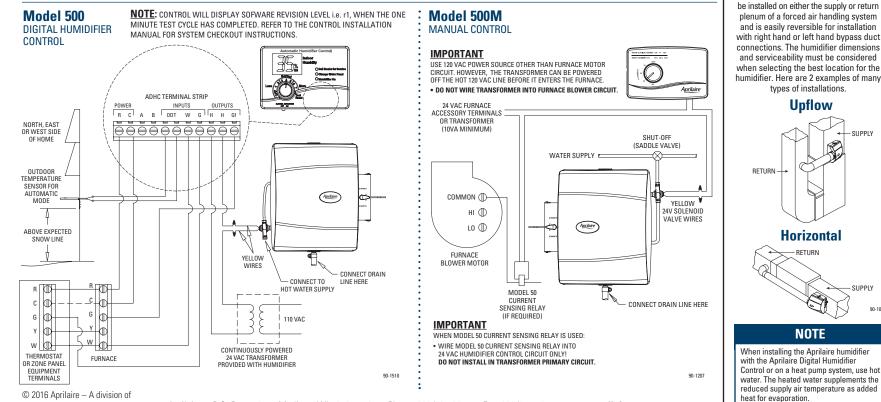

© 2016 Aprilaire - A division of **Research Products Corporation**

Aprilaire • P.O. Box 1467 • Madison, WI 53701-1467 • Phone: 800/334-6011 • Fax: 608/257-4357 • www.aprilairepartners.com

READ REVERSE SIDE FIRST!

– TOP –

READ REVERSE SIDE FIRST!

READ COMPLETE SAFETY INSTRUCTIONS AND INSTALLATION TEMPLATE BEFORE STARTING INSTALLATION

Insert feed tube into distribution

nameplate (11) if necessary, so it

damper handle (8) to "WINTER"

"SUMMER" for cooling season.

7. Control installation and wiring.

Disconnect electrical power to

In order for humidifier to operate.

furnace must be on and RH must

be below set-point of control.

detecting furnace operation.

Wiring diagrams illustrate

recommended method of


furnace before wiring control.

(open) for heating season and

is right side up. Place point bypass

tray. See Figure 2. Rotate


Figure 2



1. Press top & bottom tabs to remove cover (1). Pull feed tube (3) out of distribution tray (4). Remove Water Panel® Evaporator assembly. See Figure 1.

2. Humidifier is supplied with bypass duct connection on left. For right side bypass, swap location of drain spud (9) and cap (10). Twist to remove spud and cap.

3. Position template on supply or return plenum. Make sure template is level. Allow clearance for drain line and for servicing. Trace template outline. Cut 9-1/2" x 9-1/2" opening. Avoid injury from sharp edges.



4. Place humidifier base (2) in opening and secure with 6 screws in openings provided.

5. Select location for 6" collar on opposite plenum to minimize length and number of elbows in bypass duct. Install 6" bypass duct components. Attach duct to humidifier collar using 2 screws in openings provided.

6. Insert Water Panel Evaporator assembly into base. Make sure bottom of scale control insert (6) is in drain spud. Snap top of evaporator assembly into base.

PARTS LIST


MANUAL HUMIDIFIER CONTROL. MODEL 500M:

Manual Control can be mounted in return duct or on wall in living space. Knob and cover must be removed to mount control. See wiring diagram for 24V control connections.

- · For return duct mounting, position template at least 6" upstream of bypass duct connection or humidifier. Avoid injury from sharp edges when cutting opening. Make sure foam gasket is in place and secure control to duct using 2 screws in openings provided.
- · For wall-mount, select location that will not be affected by drafts or heat sources. Remove and discard foam gasket and secure control to wall over wire access opening using screws & anchors provided.

DIGITAL HUMIDIFIER CONTROL. MODEL 500:

- Select location for control on return duct at least 6" upstream of bypass duct connection or humidifier. Drill 3/4" hole for sensor. Knob and cover must be removed to mount control. Place control on duct with RH sensor extending into duct opening. Make sure gasket is in place around sensor cage. Secure control to duct using 2 screws in openings provided.
- See wiring diagrams on template and control instructions for 24 V control connections.



8. Humidifier will function with cold, hot, softened or unsoftened water. Hot water (140°F max) is strongly recommended to provide maximum evaporative capacity. Saddle valve provided may be used to tap into water supply. See installation instructions on saddle valve package. Saddle valve is designed to be fully opened or closed. Do not use to regulate flow.

9. Run 1/4" copper tubing from saddle valve to solenoid valve. DOUBLE-WRENCH TO PREVENT LEAKING. See Figure 3.


10. INSTALL DRAIN IN ACCORDANCE WITH LOCAL CODES. Run 1/2" I.D. hose from drain spud to floor drain. Make sure drain has constant downward slope and is not kinked. Do not over-tighten hose clamp onto drain spud. Do not use solvent adhesive on drain spud.

11. Check humidifier operation. Open saddle valve and turn control to highest setting. Turn on furnace. Allow humidifier to run until water flows from drain. Make sure all electrical connections are secure and all plumbing connections are watertight. Set control to proper setting.

NOTE: BEFORE LEAVING THE JOB SITE, MAKE SURE:

- 1. Saddle valve is fully open.
- 2. All plumbing connections are watertight.
- 3. Humidifier functions properly.
- 4. Bypass damper is in proper position.

IMPORTANT! Be sure owner's manual containing instructions for operation and warranty information is given to owner in order to avoid unnecessary calls. Warranty is void unless humidifier is installed by gualified heating and air conditioning contractor due to possible misapplication of product.

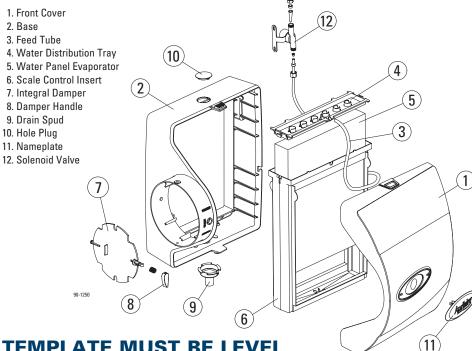

TEMPLATE MUST BE LEVEL